



DO NOT SCALE  IF IN DOUBT ASK

FIELD

INDOOR SAFE AREA

JACKING CONTROL ROOM

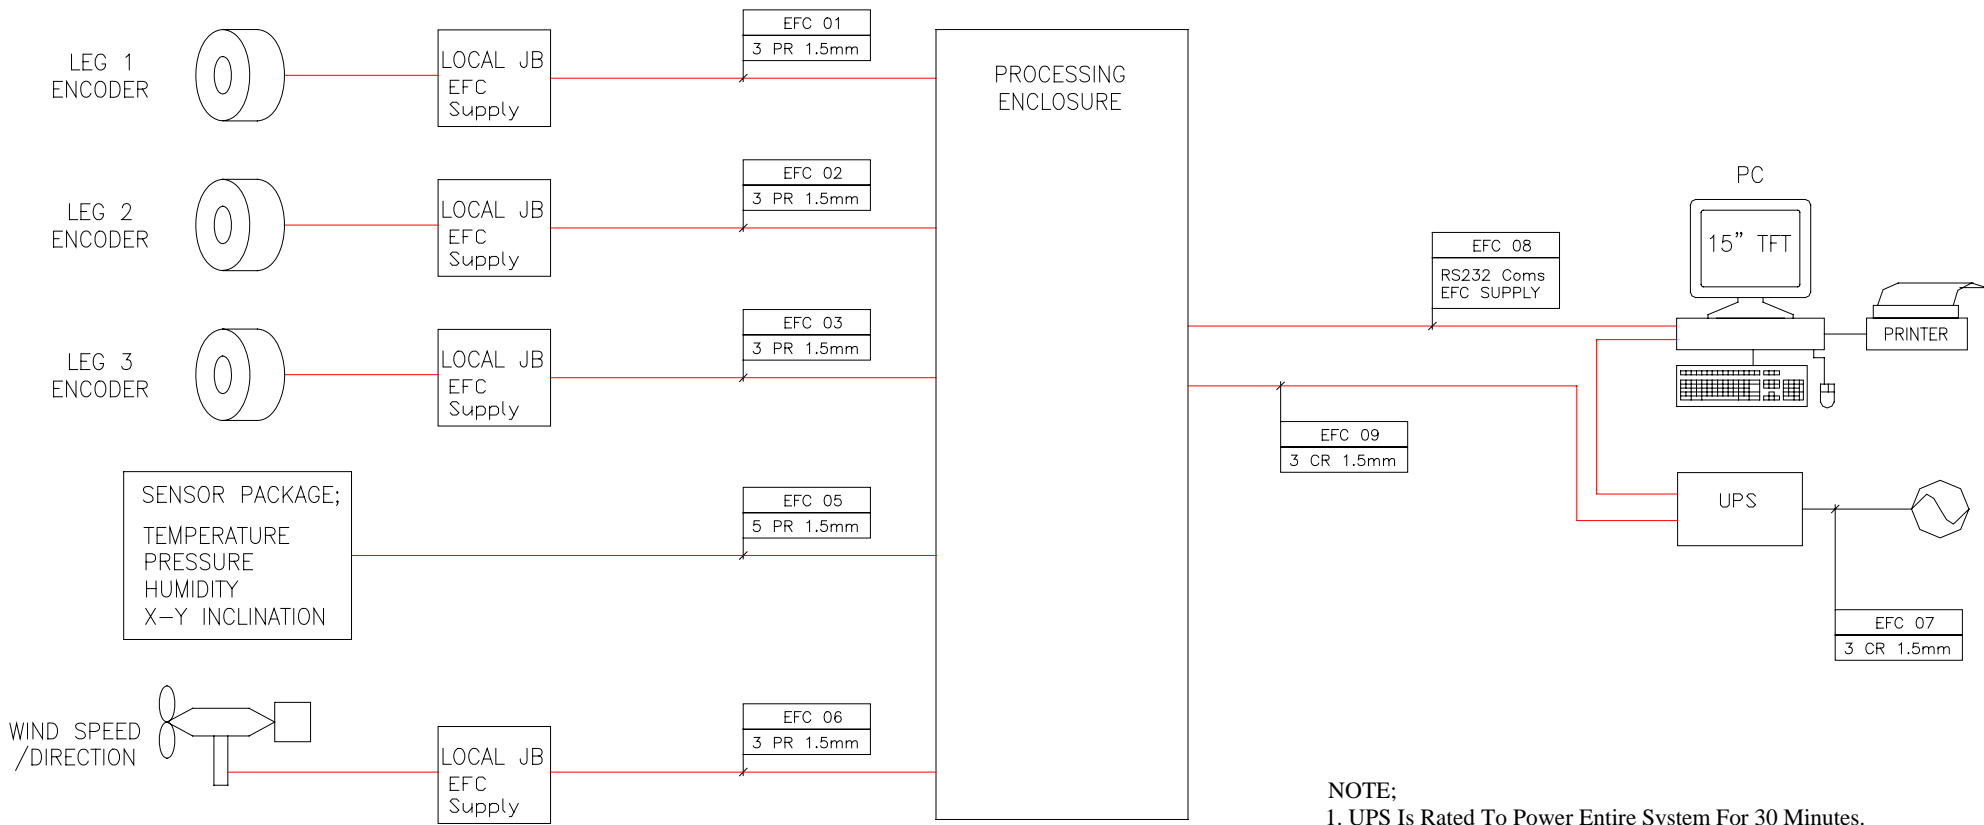

ISSUED FOR COMMENT/APPROVAL

NOTE;
 1. UPS Is Rated To Power Entire System For 30 Minutes.
 2. Cables, JBs & Glads Not Supplied Unless Otherwise Noted.